



County of San Diego, Department of Planning and Land Use
FENCES
BUILDING DIVISION

A building permit is not required for fences and free standing masonry walls not exceeding 6 feet in height or for open fences up to 8 feet in height provided the uppermost two feet consists only of barbed or razor wire and necessary support elements placed at an angle to the vertical for security purposes where allowed by fencing and landscaping regulations of the County Zoning Ordinance. The construction and location of all fences is regulated by the 2007 California Building Code as amended and adopted by the County of San Diego. This form outlines the County's minimum requirements for the construction of fences.

EXCERPTS FROM ZONING ORDINANCE § 6708

Fences and walls are permitted at the following locations provided they conform to the height limitations shown below.

1. Main Building Area. Permitted up to the maximum height applicable to the main building.
2. Front or Exterior Side Yard. Permitted up to a maximum height of 42 inches.
3. Rear or Interior Side Yards. Permitted up to a maximum height of 72 inches.

See the County Zoning Ordinance for additional information and exceptions or contact the Department of Planning and Land Use for zoning information at (858) 565-5981

FIRE-RESISTIVE CONSTRUCTION IN WILDLAND INTERFACE AREAS

Any portion of a fence within 5 feet of a building shall be constructed of non-combustible material or approved exterior fire-retardant wood or material that meets the same fire-resistive standards for exterior walls per Section 704A.3.1 of the County Building Code.

WOOD FENCES

This form does not address the design of wood fences and supporting wood posts. The following are recommendations only for wood fence construction:

- A. Wood posts of naturally durable or preservative-treated wood.
- B. Wood posts of No. 2 foundation-grade redwood, or pressure-treated Douglas fir-larch No. 2 or better.
- C. Preservative treatments applied to the ends of wood posts buried in the ground.
- D. Set posts/pipes in 12-inch diameter concrete footings extending at least 24 inches into undisturbed natural ground or properly compacted fill. Footings should be placed over 3 inches of loose gravel and wood posts should extend through concrete footings to gravel below.

CHAIN LINK FENCES

This form does not address the design of chain link fences and supporting metal posts. Sizes and spacing should be per the manufacturer's installation specifications. Metal posts/pipes should be set in 12-inch diameter concrete footings extending at least 24 inches into undisturbed natural ground or properly compacted fill. Footings should be placed over 3 inches of loose gravel and metal posts should extend through concrete and terminate with 3 inches of concrete cover at base of footing.

5201 RUFFIN ROAD, SUITE B, SAN DIEGO, CA 92123 • (858) 565-5920 • (888) 336-7553
[HTTP://WWW.SDCDPLU.ORG](http://www.sdcdplu.org)

MASONRY FENCES

A. Masonry Blocks

Concrete masonry units shall conform to ASTM C90 Grade N units with $F'_m \geq 1,500$ psi and all cells grouted solid.

The first course of block shall be set into the fresh concrete when the footing is poured and a good bond must be obtained.

B. Concrete

Concrete for footings must have a minimum compressive strength of 2,500 psi at 28 days. Cement shall conform to ASTM C 150. (Note: Plastic cement is not permitted.)

C. Mortar

The mortar mix must have a compressive strength equal to 1,800 psi minimum. Mortar for use in masonry construction shall conform to ASTM C 270 and shall conform to the proportion specifications of CBC Table 2103.8(1) or the property specifications of CBC Table 2103.8(2).

D. Grout

The grout must have a compressive strength equal to 2,000 psi minimum. Grout shall conform to CBC Table 2103.12 or to ASTM C 476.

E. Reinforcing Steel

Reinforcing steel must be deformed and comply with ASTM A 615, Grade 40 or 60. When one continuous bar cannot be used, a lap or splice of 40-bar diameters is required. All bars shall be clean of loose flaky rust, grease or other materials likely to impair bond.

Reinforcement in concrete shall be protected from corrosion and exposure to chlorides. Concrete protection for reinforcement shall be at least 3" to earth when the concrete is poured against the earth.

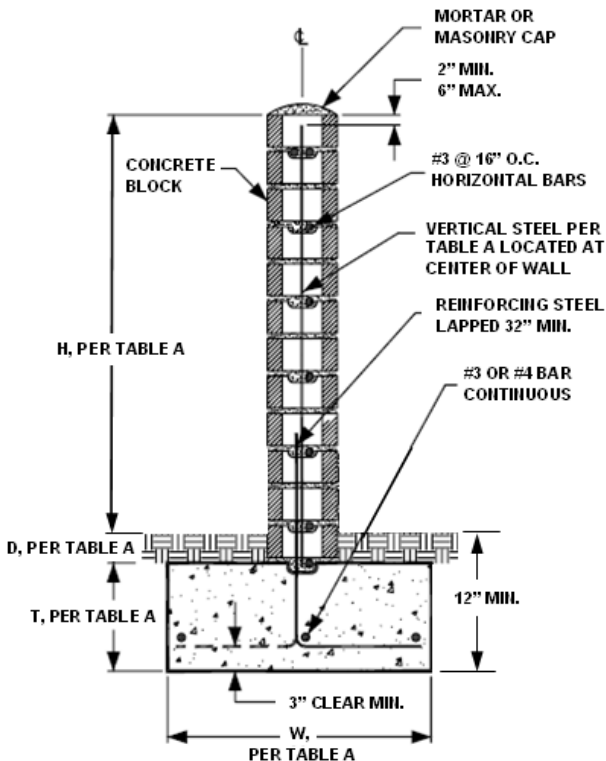


TABLE A: REQUIREMENTS FOR MASONRY FENCES

H (Fence Height)	Concrete Block Size	W (Footing Width)	T (Footing Thickness)	D (Depth of Top Soil)	Vertical Reinforcing Steel
4'-0"	6"	12"	8"	4"	#3 @ 24" o.c.
	8"	12"	8"	4"	#3 @ 24" o.c.
5'-0"	6"	18"	8"	4"	#4 @ 24" o.c.
	8"	18"	8"	4"	#3 @ 24" o.c.
6'-0"	8"	24"	8"	4"	#4 @ 24" o.c.

SPECIAL INSPECTION NOT REQUIRED